


BARRIERS

A FIRE-RESISTANT BARRIER MAY BE CONSTRUCTED IN LIEU OF THE SEPARATION. THE FOLLOWING METHODS ARE ACCEPTABLE:


1. NON-COMBUSTIBLE WALLS

THE BARRIER SHALL EXTEND TO A LINE PROJECTED FROM THE CORNER OF THE PADMOUNT TO THE FURTHEST CORNER OF THE WINDOW, DOOR OR OPENING IN QUESTION. THE HEIGHT OF THE BARRIER SHALL BE 1' ABOVE THE TOP OF THE PADMOUNT TRANSFORMER. SEE FIGURE 5 BELOW.

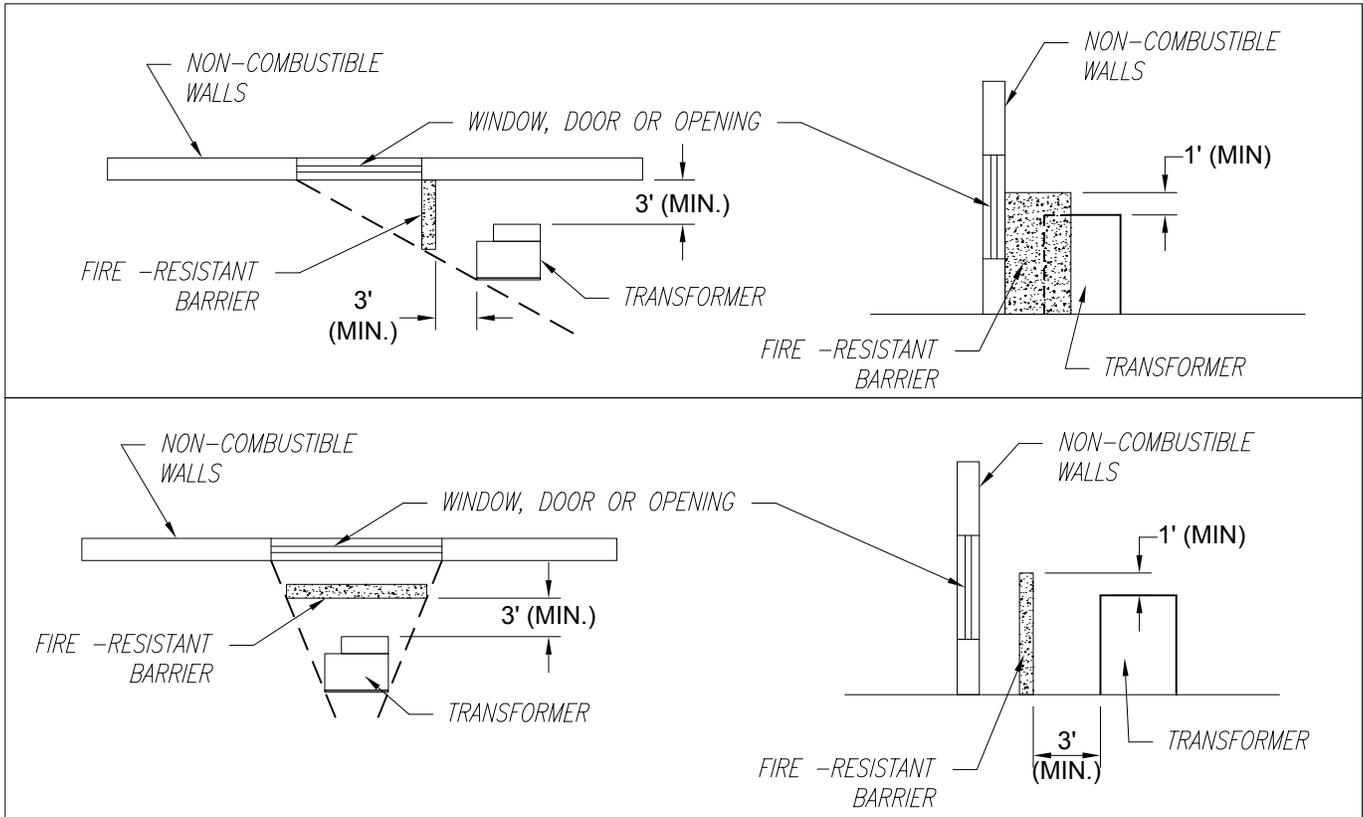

2. COMBUSTIBLE WALLS

THE BARRIER SHALL EXTEND 3' BEYOND EACH SIDE OF THE PADMOUNT TRANSFORMER. THE HEIGHT OF THE BARRIER SHALL BE 1' ABOVE THE TOP OF THE TRANSFORMER.

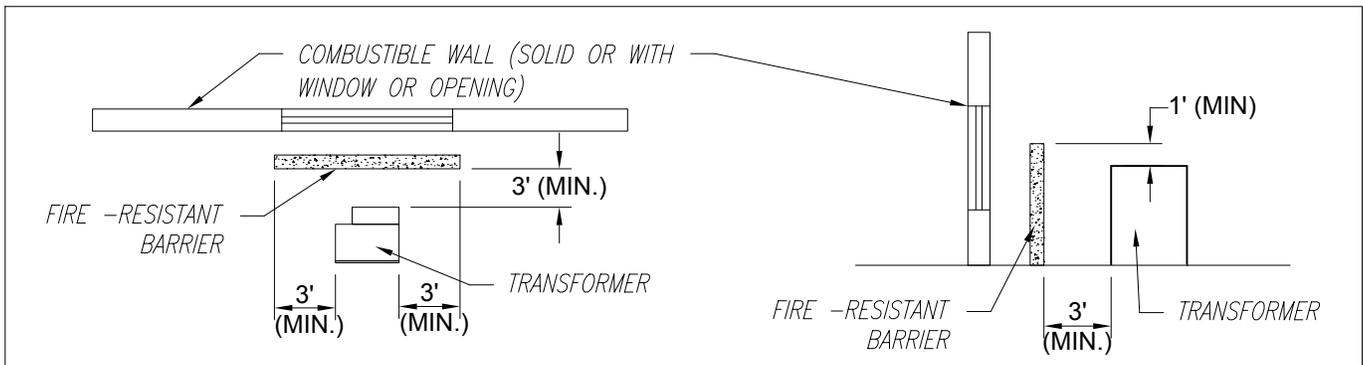

SPECIFICATIONS
DULUTH, MINNESOTA

CLEARANCE REQUIREMENTS FOR PADMOUNT TRANSFORMER OUTDOOR LOCATION NEAR BUILDING WINDOW / OPENING USING BARRIERS